
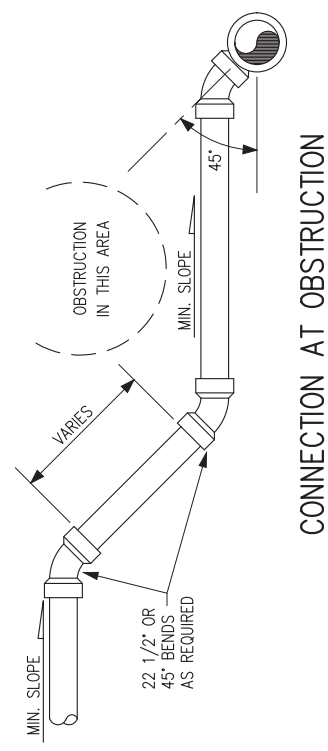
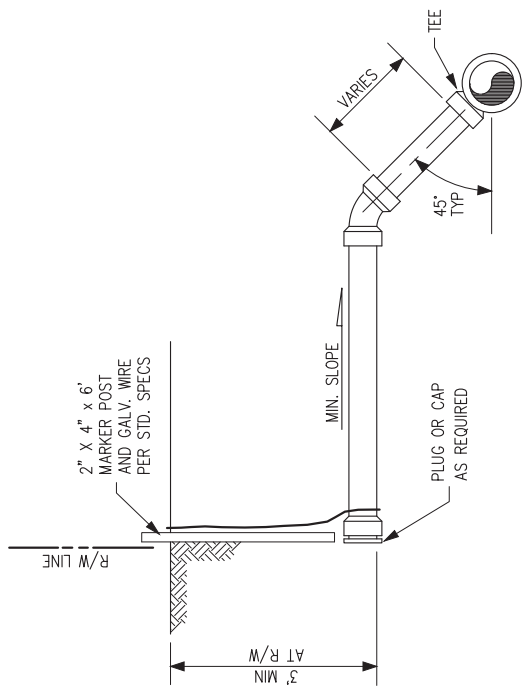


- NOTES:
1. SIDE SEWERS SHALL BE INSTALLED IN ACCORDANCE WITH SEC. 7-18 OF THE STANDARD SPECIFICATIONS
 2. SERVICE CONNECTIONS 8" OR LARGER MUST BE MADE AT MANHOLE.
 3. IF 5' MAXIMUM SLOPED DISTANCE IS INSUFFICIENT FOR SIDE SEWER CONNECTION, INSTALL SIDE SEWER RISER PER DETAIL.
 4. ROTATE SANITARY SEWER MAIN TEE OR WYE 45° UPWARD.
 5. TEES OR WYES SHALL BE INSTALLED IN NEW SANITARY SEWER MAINS. WHEN INSTALLING SIDE SEWERS IN EXISTING MAINS, CONNECTION SHALL BE MADE BY MACHINE MADE TAP AND APPROVED SADDLE.
 6. WHERE DEPTH IS INSUFFICIENT TO ALLOW CONNECTION AS SHOWN, CONNECT SERVICE AS DIRECTED BY THE PUBLIC WORKS DIRECTOR.
 7. TERMINATE SIDE SEWER AT R/W LINE UNLESS OTHERWISE DIRECTED BY THE PUBLIC WORKS DIRECTOR OR SHOWN OTHERWISE ON PLANS.
 8. ALL SIDE SEWER MATERIALS SHALL BE PVC SEWER PIPE CONFORMING TO THE REQUIREMENTS OF SECTION 9-05.12 OF THE STANDARD SPECIFICATIONS.
 9. ALL 4" OR 6" SIDE SEWERS SHALL BE INSTALLED WITH A MINIMUM OF 3" OF IMPORTED CRUSHED ROCK PIPE BEDDING AROUND PIPE.

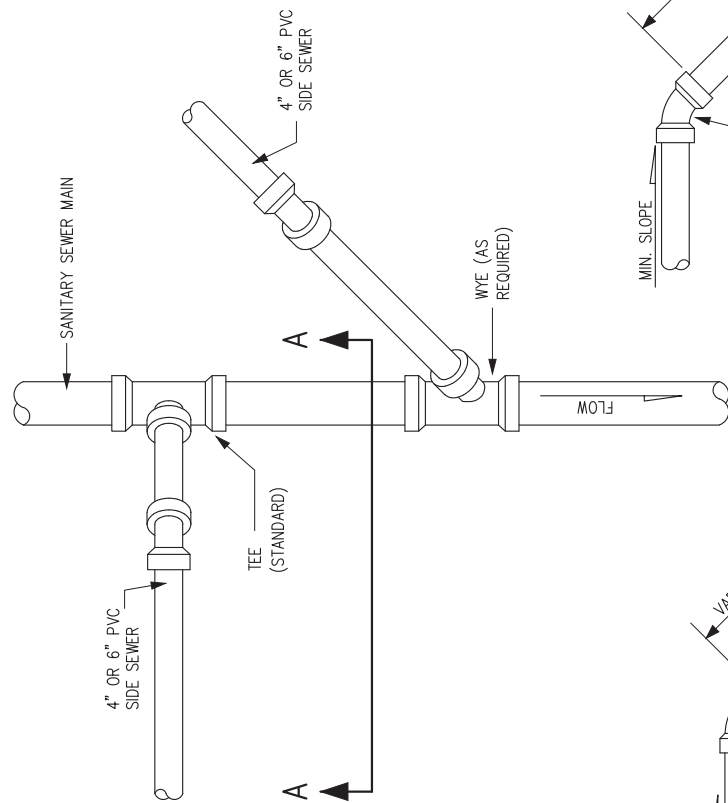

SIDE SEWER CONNECTIONS

NOT TO SCALE

- NOTES:
- ONLY THE LATEST DETAIL, AS APPROVED BY THE DIRECTOR OF PUBLIC WORKS, SHALL BE USED.

ORIG.	10/06		
Revision	Date	Description	Appr